

TOWN OF FARMINGTON

1000 County Road #8
Farmington, NY 14425
(315) 986-8100


APPENDIX: **W - 16.0**

DATE: 2023

SCALE: N.T.S.


MRB | group

NOTE:
12' MAX. DISTANCE BETWEEN SPACERS.
CASING SPACERS SHALL BE SPACED A
MINIMUM OF 1'-0" FROM EACH SIDE OF
JOINT.

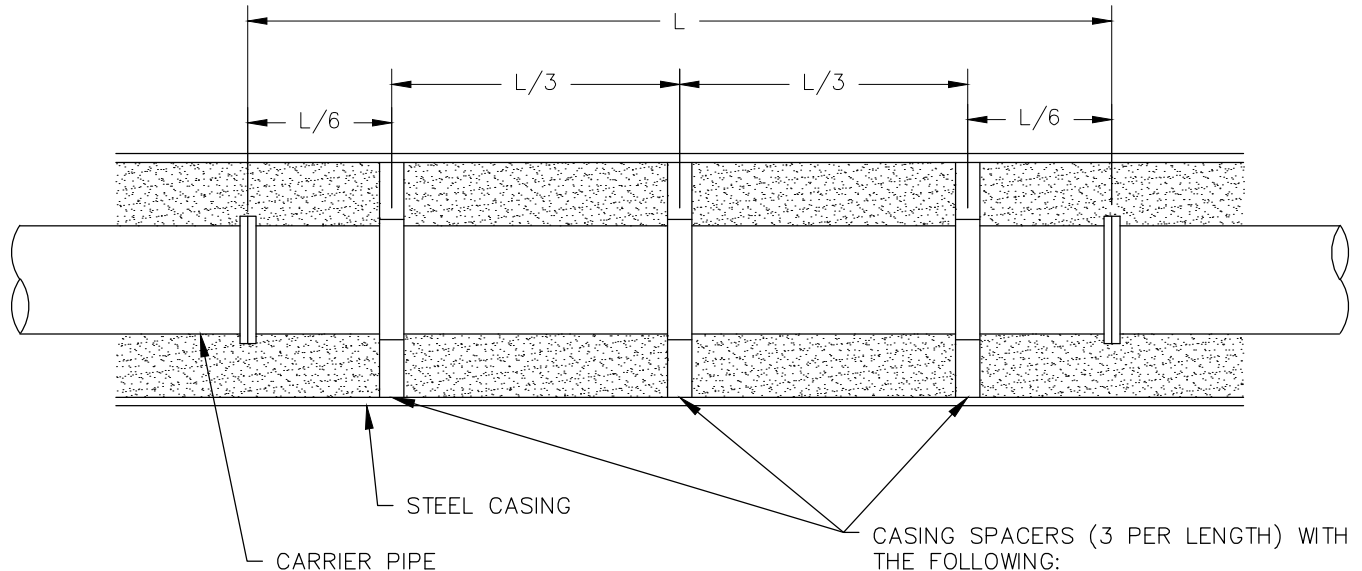

- 14 GAUGE T304 STAINLESS CLAMPS
- PVC LINERS
- STAINLESS STEEL BOLTS
- POLYMER RUNNERS

WELDED, COATED STEEL SLEEVE
PER ASTM A-139 JACKED OR
BORED UNDER ROAD

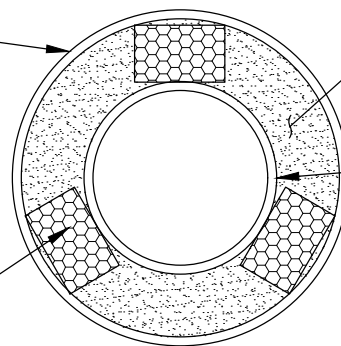

FILL ALL VOIDS WITH FLOWABLE FILL

WATERMAIN OR SEWER MAIN

SPACERS ATTACHED TO MAIN
TO FACILITATE INSTALLATION

MAIN SIZE	MINIMUM CASING O.D.	MIN. WALL THICKNESS FOR STEEL CASING
4"	10"	0.188"
6"	12"	0.188"
8"	16"	0.239"
12"	20"	0.281"
16"	26"	0.375"

PIPE CASING DETAIL